




EXISTING CIPP LINER


EXISTING SANITARY SEWER PIPE

EXISTING CONDITION



SANITARY SEWER SERVICE WYE BRANCH

EXISTING SANITARY SEWER PIPE

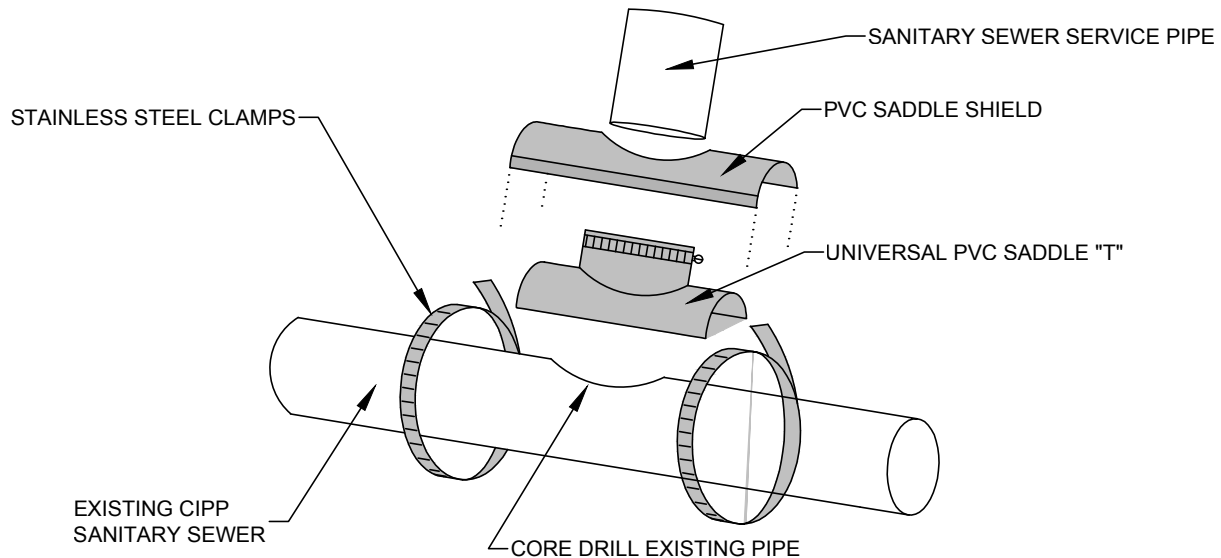

PROPOSED CONDITION

NOTE:

1. FOR 4" OR 6" SERVICES, INSTALL PIPECONX SADDLE TEE OR APPROVED EQUAL.
2. FLEXIBLE SADDLE MUST BE INSTALLED IN COMBINATION WITH SADDLE SHIELD.
3. FOR EXISTING SERVICES, REMOVE SERVICE BRANCH PRIOR TO INSTALLING PVC SADDLE.

DESIGN:	DATE:	 ENGINEERING DEPARTMENT SANITARY SEWER SERVICE INSTALLATION FOR CIPP	PLATE NUMBER
DRAWN: DRT			
REVISIONS: 10/11/18			S-9